
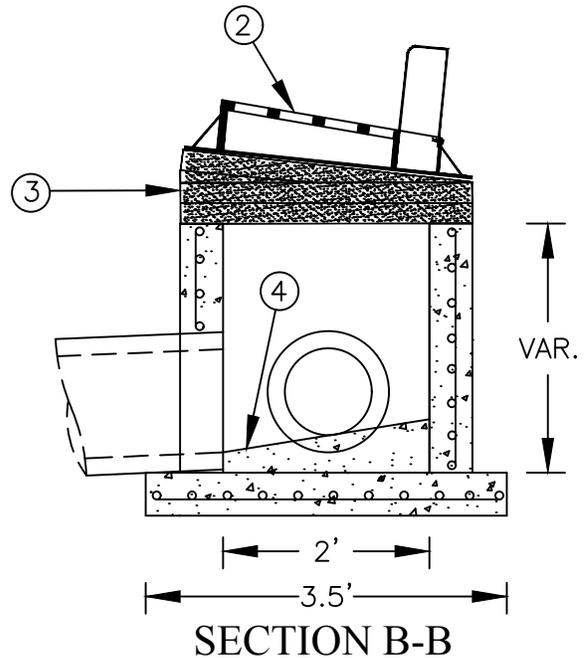
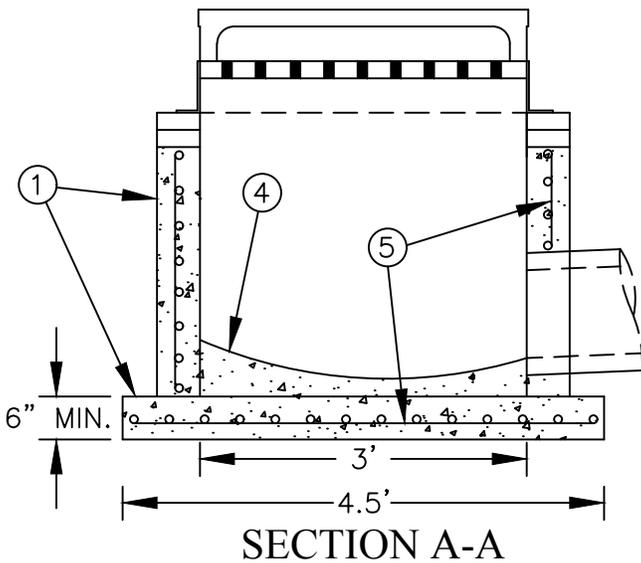


NOTES:

- ① PRECAST CONCRETE 2'X3' CATCH BASIN BOX WITH 5" (MIN.) WALLS AND PRECAST CONCRETE 3.5'X4.5' BASE SLAB WITH 6" (MIN.) THICKNESS. PRECAST INTEGRAL BASE SUBJECT TO APPROVAL BY THE ENGINEER.
- ② REFER TO PLANS AND/OR SPECIAL PROVISIONS FOR FRAME AND GRATE TYPE.
- ③ SEE PLATE NO. 1-01 FOR FRAME AND GRATE ADJUSTMENT.
- ④ ALL CONCRETE INVERTS SHALL HAVE A MINIMUM OF 2" CONCRETE DEPTH WITH A MINIMUM SLOPE OF 1/4" PER FOOT TO OUTLET. FLOW LINES SHALL BE FORMED TO APPROXIMATE SHAPE OF THE LOWER 4" OF THE OUTLET PIPE.
- ⑤ REINFORCING SHALL BE A MINIMUM OF SINGLE LINE STEEL WIRE FABRIC HAVING AN AREA OF NOT LESS THAN 0.12 SQ. IN. PER FOOT EACH DIRECTION.
6. BLOCK-BRICK CONSTRUCTION IS SUBJECT TO APPROVAL BY THE ENGINEER.

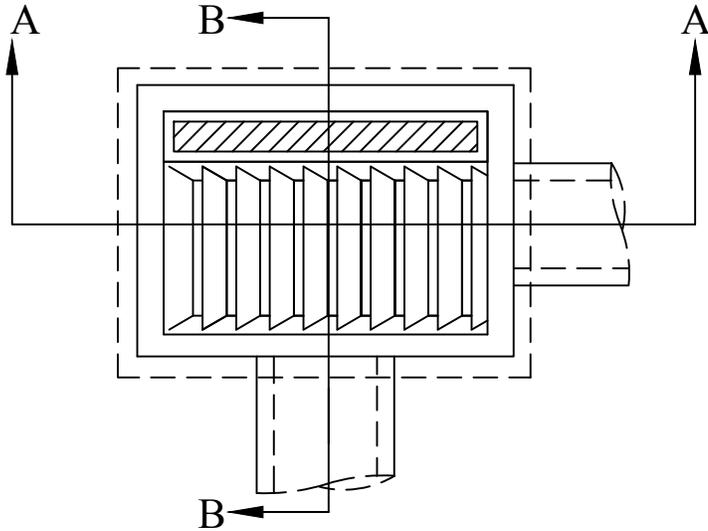

DATE REVISED
03/01/08

2'X3' STANDARD CB

PLATE NO.
1-02