


 = 7" CONCRETE PAVEMENT
MnDOT SPEC. MIX 3A32

SECTION A-A

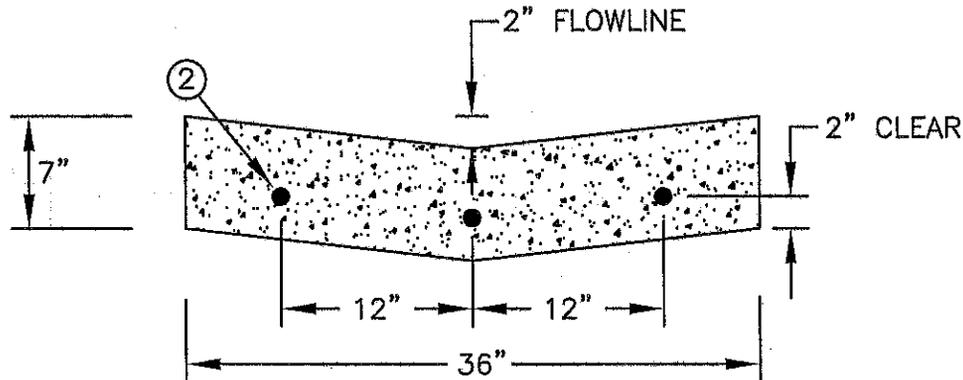

NOTES:

- ① PROVIDE 1/2" EXP. JT.
- ② CONSTRUCT 3-#5 EPOXY COATED REINFORCING BARS (GR. 60). OVERLAP 24" AT SPLICES.
- ③ PROVIDE CONTRACTION JOINTS ACROSS VALLEY GUTTER AT 10' MAX. SPACING.
4. ADDITIONAL CONTRACTION JOINTING IN THE WING SECTIONS OF VALLEY GUTTER SHALL BE FIELD DETERMINED BY THE ENGINEER.
- ⑤ CURB AND GUTTER RADII SHALL BE CONSTRUCTED INTEGRALLY WITH VALLEY GUTTER.
- ⑥ FLOWLINE TRANSITIONS FROM CURB AND GUTTER THROUGH VALLEY GUTTER SHALL BE FIELD DETERMINED BY THE ENGINEER.
7. CURB CUTS SHALL BE PLACED IN RADII AS DIRECTED BY THE ENGINEER TO FACILITATE PEDESTRIAN RAMP CONSTRUCTION. (SEE PLATE NO. 3-08 AND PLATE NO. 3-02)
8. CONCRETE TO BE CONSTRUCTED ON A PROPERLY COMPACTED BASE.
- ⑨ CONCRETE MAY BE EXPANDED BEHIND 36" GUTTER. SEE PLAN FOR SPECIFIC DIMENSIONING.

DATE REVISED

07/05/11

CONCRETE VALLEY GUTTER

PLATE NO.

3-07